

Project Information

Reference Thermic Technology 140240-5
 Date 11/2/20
 Client Timber Frame Solutions
 Tel: 01257 241084
 Email: info@thermictechnology.co.uk

This 4-page document contains:

- U-value calculation
- Condensation risk analysis
- CAD drawing of wall structure

Construction Type

Element	: Wall - 140 - PhotonWrap - 0.035 - PhotonFoil - 0.17				
Timber framed wall					
Internal surface emissivity	: High	External surface emissivity		: High	
		Thickness	Thermal Conductivity	Thermal Resistance	Pitch Bridge details
		(mm)	(W/mK)	(m ² K/W)	(°) Air gaps
					(Level, Delta U")
Outside surface resistance	-	-	-	0.040	
Brick - outer leaf (BRE)	103.0	0.770	0.134		17.332% Mortar (103.0mm)
Cavity	50.0	-	-	0.665	
(Un-vented cavity - width=562.0mm, hro=5.100, E1=0.050, E2=0.900, horizontal heat flow)					
PhotonWrap reflective breather membrane	0.5	0.030	0.017		L:0 0.000W/m ² K
OSB (BS5250)	9.0	0.130	0.069		L:0 0.000W/m ² K
Earthwool FrameTherm Roll 35	140.0	0.035	4.000		15.000%
					Prefabricated panels (140.0mm)
					L:0 0.000W/m ² K
PhotonFoil	33.0	0.034	0.971		6.333%
					Compressed PhotonFoil and Timber (33.0mm)
50x38mm batten cavity	23.0	-	-	0.665	6.333% Softwood (~500kg/m ³) (23.0mm)
(Bridged un-vented cavity - width=550.0mm, hro=5.100, E1=0.050, E2=0.900, horizontal heat flow)					
Plasterboard (BS5250)	12.5	0.170	0.074		
Plaster, lightweight (BS5250)	3.0	0.220	0.014		
Inside surface resistance	-	-	-	0.130	

U-value = 0.17W/m²K

U-value, Combined Method : 0.173W/m²K (upper/lower limit 6.027 / 5.523m²K/W, dUf 0.0000, dUg 0.0000, dUp0.0000, dUr0.0000, dUrc1 0.0000, dUrc2 0.0000)

Correction factors

Air gaps, Delta Ug = 0.000W/m²K

(Based on the combined method for determining U-values of structures containing repeating thermal bridges)

	Thickness (mm)	Thermal Conductivity (W/mK)	Thermal Resistance (m ² K/W)	Vapour Resistivity (MNs/gm)	Vapour Resistance (MNs/g)
Outside surface resistance	-	-	0.040	-	-
Brick - outer leaf (BRE)	103.0	0.770	0.134	50.00	5.15
Cavity (Un-vented cavity - width=562.0mm, hro=5.100, E1=0.050, E2=0.900, horizontal heat flow)	50.0	-	0.665	-	0.26
PhotonWrap reflective breather membrane	0.5	0.030	0.017	50.00	0.03
OSB (BS5250)	9.0	0.130	0.069	500.00	4.50
Earthwool FrameTherm Roll 35	140.0	0.035	4.000	5.00	0.70
PhotonFoil	33.0	0.034	0.971	-	192.00
50x38mm batten cavity (Bridged un-vented cavity - width=550.0mm, hro=5.100, E1=0.050, E2=0.900, horizontal heat flow)	23.0	-	0.665	-	0.13
Plasterboard (BS5250)	12.5	0.170	0.074	60.00	0.75
Plaster, lightweight (BS5250)	3.0	0.220	0.014	30.00	0.09
Inside surface resistance	-	-	0.130	-	-


Condensation Risk Analysis (no account taken of thermal bridges)


3 - Dwellings with low occupancy

Jan (worst)	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
20.0C 48.8%	20.0C 48.9%	20.0C 50.7%	20.0C 52.9%	20.6C 56.3%	22.1C 59.2%	22.9C 60.8%	22.9C 60.7%	21.8C 58.5%	20.3C 55.6%	20.0C 51.3%	20.0C 49.5%
3.8C 83.0%	3.9C 81.0%	5.7C 76.5%	7.9C 74.0%	11.3C 71.5%	14.2C 73.5%	15.8C 75.5%	15.7C 76.5%	13.5C 78.5%	10.6C 81.0%	6.3C 82.5%	4.5C 83.5%

	Interface Temp. °C	Dewpoint Temp. °C	Vapour Pressure (kPa)	Saturated V.P. (kPa)	Worst Cond. (g/m ²)	Peak Buildup (g/m ²)	Condensation
1 Outside surface resistance							
2 Brick - outer leaf (BRE)	3.9	1.2	0.67	0.81			No
3 Cavity	4.2	1.4	0.68	0.83			No
4 PhotonWrap reflective breather membrane	5.8	1.4	0.68	0.92			No
5 OSB (BS5250)	5.8	1.4	0.68	0.92			No
6 Earthwool FrameTherm Roll 35	6.0	1.7	0.69	0.94			No
7 PhotonFoil	15.6	1.7	0.69	1.77			No
8 50x38mm batten cavity	17.9	8.9	1.14	2.05			No
9 Plasterboard (BS5250)	19.5	8.9	1.14	2.26			No
10 Plaster, lightweight (BS5250)	19.7	8.9	1.14	2.29			No
11 Inside surface resistance	19.7	8.9	1.14	2.29			No

Worst case internal / external conditions for graph : 20.0°C @ 48.8%RH / 3.8°C @ 83.0%RH

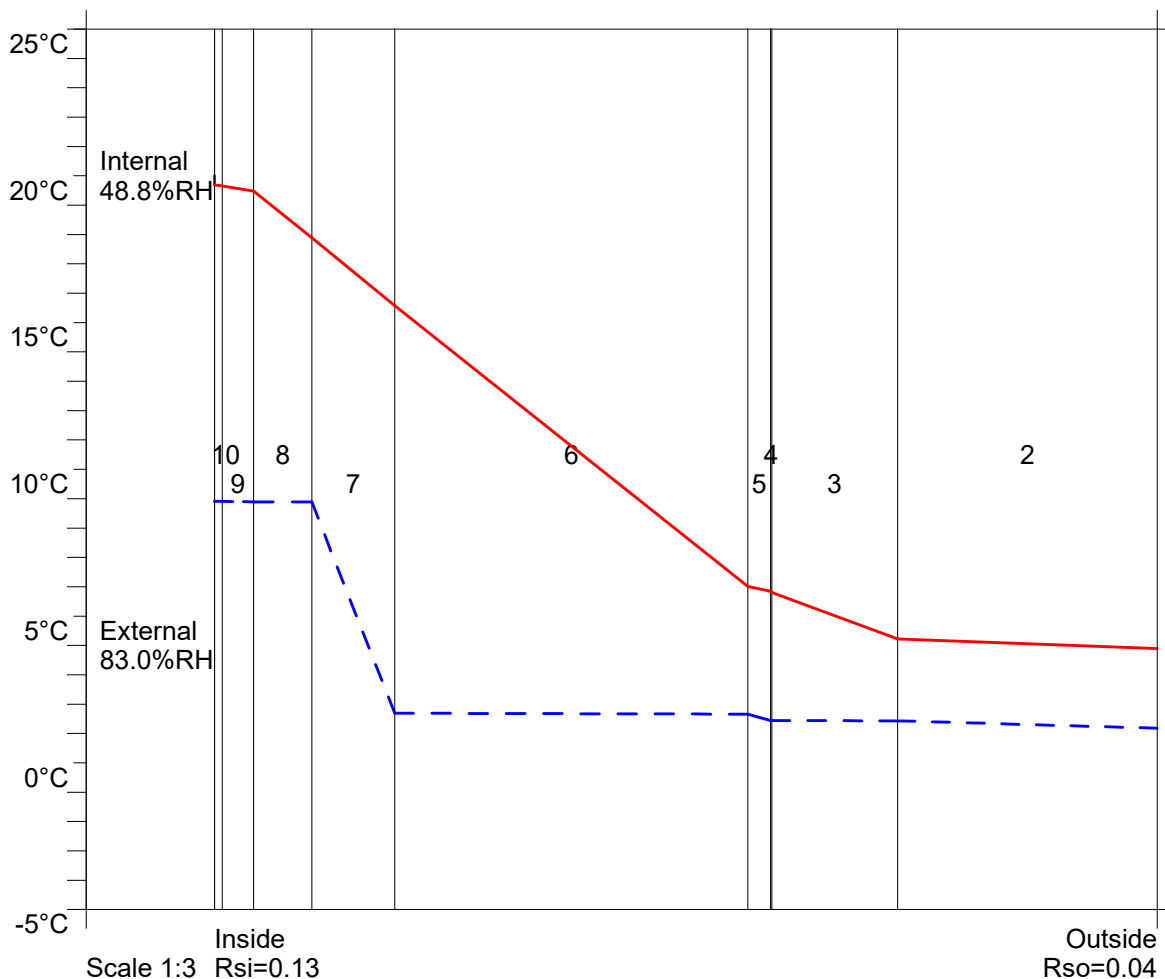

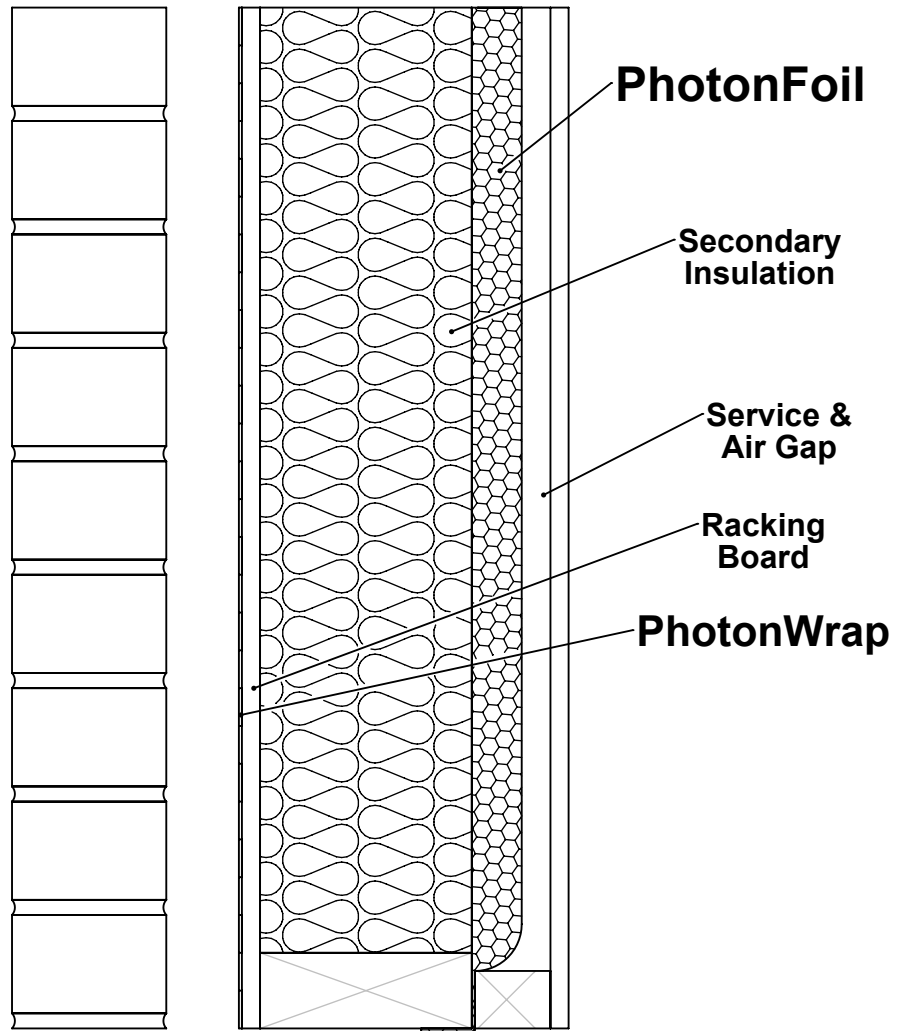

TF_Brick_PhotonFoil+PhotonWrap

2D CAD

Thermic Technology Ltd
Issue: October 2017 A4